


### Cylinder versions .20-->:

- iLOQ 2-wire bus is for N001 Net Box connection. Black=gnd, Yellow=data.
- External input is for controlling conditional access by any potential free contact information.
- RTC-bus is for connecting A00.1 Real time clock

In case of both, Net Box and RTC are connected, primary clock source is Net Box. RTC is as a back up.

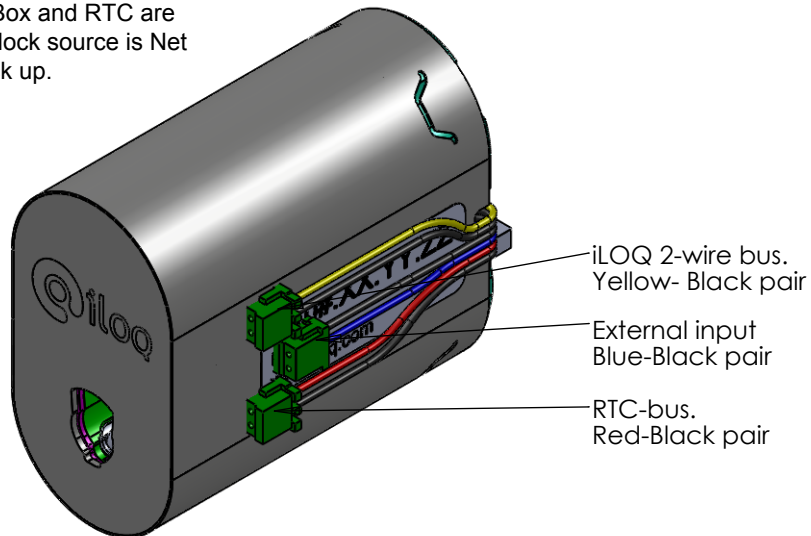

---

### Cylinder versions .17 and .18:

- RTC / iLOQ 2-wire bus is for N001 Net Box connection (Black=gnd, Red=data) or for A00.1 Real time clock.
- External input is for controlling conditional access by any potential free contact information. Older than .17 versions have black-black pair instead of Yellow-Blue.

